

**DOME® BOW BRACKET by HEATSAIL**

# TECHNICAL INFORMATION



**RUSTPROOF &  
WEATHERPROOF**



**LOW ENERGY USAGE  
ZERO CO2 EMISSION**



**MINIMUM OF  
MAINTENANCE**

## DOME® BOW BRACKET by HEATSAIL

### FEATURES



IP  
43

CE



**RUSTPROOF &  
WEATHERPROOF**

The DOME is made out of high quality material such as Aluminium and Stainless steel, making it suitable for outdoor use.



**LOW ENERGY USAGE  
ZERO CO2 EMISSION**

With an energy consumption of only 3.22 kW/h, the DOME uses less energy than similar products delivering optimal heating.



**MINIMUM OF  
MAINTENANCE**

By using high efficient and durable ceramic heating elements and the best materials, the DOME is virtually maintenance free.



**PATENTED  
DESIGN**

The unique patented design makes the DOME an absolute eyecatcher, exuding luxury, elegance and exclusivity.



#### Headquarters

Prins Boudewijnlaan 7 Unit A 08  
2550 Kontich  
Belgium  
+ 32 3 502 99 88

#### North American office


10440 N Central Expressway  
Suite 800, Dallas, Texas 75231  
United States  
+ 1 (214) 808 5091

**W:** [www.heatsail.com](http://www.heatsail.com)

**E:** [sales@heatsail.com](mailto:sales@heatsail.com)

## DOME® BOW BRACKET by HEATSAIL

### DIMENSIONS

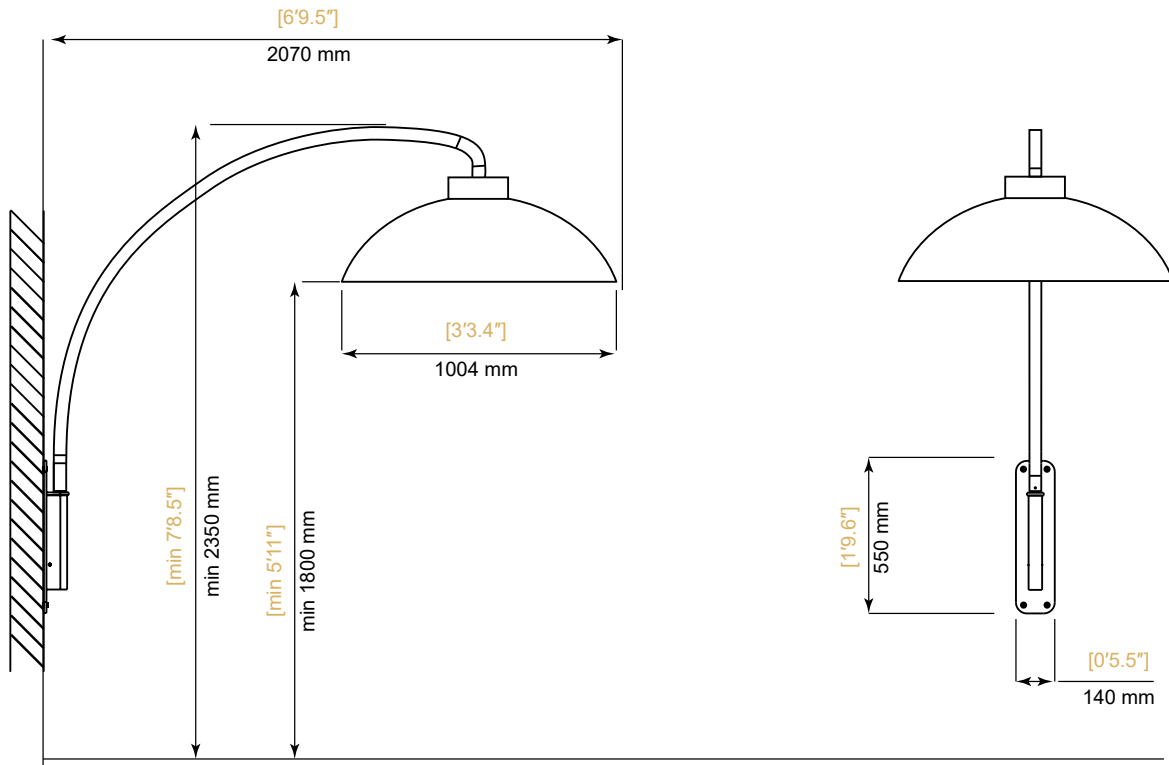

### SPECIFICATIONS

Model	DOME BOW BRACKET
Heat output (W)	3100 W
Light Output (W)	120 W
Electrical connection	208V AC - 60 Hz 20 A
Dimensions (WxDxH)	270 x 1004 x 2350 mm - [6'9.5" x 3'3.4" x 7'8.5"]
Mounting height requirement to ground	min 1800 mm; max 1950 mm - [min 5'11"; max 6'4.8"]
Weight	approx. 25,5 kg and needs to be anchored - [56 lbs]
Approvals	UL 60335-1, CAN/CSA-C22.2 No. 60335-1:16, CAN/CSA-E60335-2-30:13, IEC 60335-2-30, CE



**Headquarters**  
Prins Boudewijnlaan 7 Unit A 08  
2550 Kontich  
Belgium  
+ 32 3 502 99 88

**North American office**  
10440 N Central Expressway  
Suite 800, Dallas, Texas 75231  
United States  
+ 1 (214) 808 5091

**W:** [www.heatsail.com](http://www.heatsail.com)  
**E:** [sales@heatsail.com](mailto:sales@heatsail.com)

## DOME® BOW BRACKET by HEATSAIL

### ELECTRICAL SAFETY REQUIREMENTS

The use of the DOME requires an electrical installation with reliable safety grounding.


The installation's electrical safety can only be guaranteed if the device has been correctly connected to an grounding system built in accordance with the safety instructions. A preliminary inspection is absolutely essential. In the event of any uncertainty, a careful inspection must be made by a qualified and authorized technician. Heatsail will not be held responsible for injury and/or damage resulting from an ungrounded installation.

**The installation of the DOME's electrical components requires a mains connection of 208V AC-60 Hz (20 amp fuse appropriate RCD): the connection must be properly implemented in accordance with the applicable IEC-CEI standards. Please note: statutory and other regulation may apply locally. This product must be installed by a Qualified Electrician and the power supply connection should be in accordance with the requirements of NFPA 70 and OSHA Regulations 29 CFR 1910.304(b)(2).**

A switch must be installed between the DOME and the fuse box at all times. Non-compliance with these instructions may compromise the safety of the device. Heatsail will not be held liable for any damage resulting from this.

### CONSTRUCTING OVERVIEW

The DOME is mounted on a vertical surface by means of a stainless steel bracket. This bracket should be hung by using the correct plugs and screws according to the mounting surface.

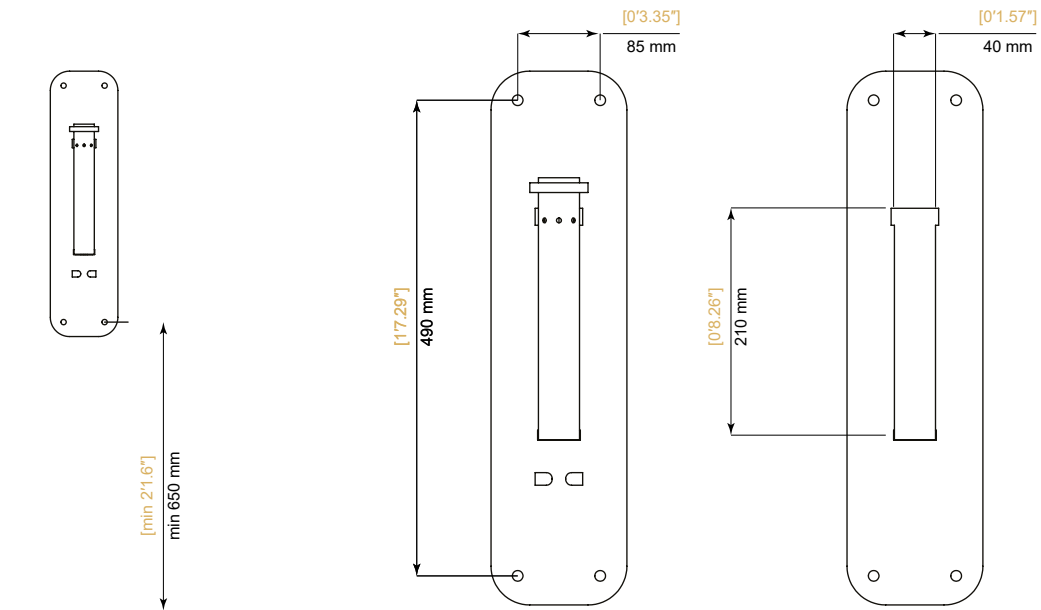

**Headquarters**  
Prins Boudewijnlaan 7 Unit A 08  
2550 Kontich  
Belgium  
+ 32 3 502 99 88

**North American office**  
10440 N Central Expressway  
Suite 800, Dallas, Texas 75231  
United States  
+ 1 (214) 808 5091

**W:** [www.heatsail.com](http://www.heatsail.com)  
**E:** [sales@heatsail.com](mailto:sales@heatsail.com)

## DOME® FS by HEATSAIL

### ELECTRICAL OVERVIEW


The DOME WALL BRACKET consists of a central heater element with a light and a hood, which serves as protection and reflection of the far infrared rays. The central element is called 'heattube'. On the lower part you will find a 'heater block' with 5 rectangular and 1 round heater element. Above the heater element there is a halogen light, separated from the heater element. The light consists of a R7S 78 mm halogen bulb, at 208-240V AC, behind a heat resistant glass. The glass can be pulled downwards (see user manual) to be able to change the halogen bulb. Because of the high heat a LED lamp is not possible, as LED can not withstand these high temperatures.

There are three electrical circuits in the DOME. These circuits have a total of 20 Amps at 208V AC.

- Circuit 1: Heating circuit 1 consists of four rectangular heater elements and has a total heat output of 1500 W at 208V AC
- Circuit 2: Heating circuit 2 consists of the lower round heating element and two opposite rectangular heater elements and has a total power of 1600 W at 208V AC.
- Circuit 3: Lighting circuit consists of a R7S bulb of 120 W at 208V AC

### WALL SWITCHES

The incoming power is divided over the 3 circuits through 3 wall switches installed by a qualified electrician. The output lines of the wall switches will consist of 5 lines in a size not less than 1.5 mm<sup>2</sup> / 16 AWG according to the following indicative drawing:

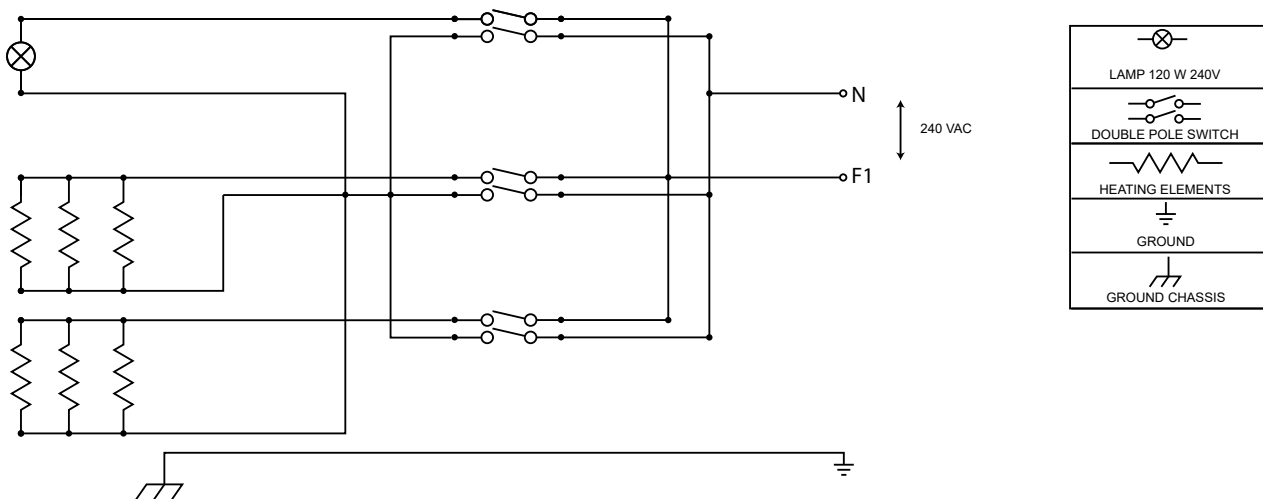

**To connect the DOME to the main power, a single phase connection is required consisting of 2 hot wire and 1 grounding wire in a size not less than 2.5 mm<sup>2</sup> / 14 AWG.**



**Headquarters**  
 Prins Boudewijnlaan 7 Unit A 08  
 2550 Kontich  
 Belgium  
 + 32 3 502 99 88

**North American office**  
 10440 N Central Expressway  
 Suite 800, Dallas, Texas 75231  
 United States  
 + 1 (214) 808 5091

**W:** [www.heatsail.com](http://www.heatsail.com)  
**E:** [sales@heatsail.com](mailto:sales@heatsail.com)